### WILKINS a ZURNe company

# Model 350 Double Check Valve Assembly

## SPECIFICATION SUBMITTAL SHEET





#### FEATURES

Sizes:3/4"1"1-1/4"1-1/2"2"Maximum working water pressure175 PSIMaximum working water temperature180°FHydrostatic test pressure350 PSIEnd connections ThreadedANSI B1.20.1


#### OPTIONS

(Suffixes can be combined)

- with full port QT ball valves (standard)
- L less ball valves, male pipe thread
- XL with low lead ball valves (See 350XL)
- □ S with bronze "Y" type strainer
- □ SH with stainless steel handles
- $\hfill\square$   $\hfill$  FT  $\hfill$  with integral male 45° flare SAE test fitting
- BOF with Blow-Out / Flush fitting

#### ACCESSORIES

- Repair kit
- □ Thermal expansion tank (Model XT)
- QT-SET Quick Test Fitting Set
- Test Cock Lock (Model TCL24)
- Winterizing Blow-Out/Flush fitting (RK34-350BOF, RK1-350BOF or RK114-350-375BOF)



#### DIMENSIONS & WEIGHTS (do not include pkg.)

#### APPLICATION

Designed for installation on water lines to protect against both backsiphonage and backpressure of polluted water into the water supply. Assembly shall provide protection where a potential health hazard does not exists.

#### STANDARDS COMPLIANCE (Horizontal & Vertical)

- ASSE® Listed 1015
- IAPMO® Listed
- CSA® Certified B64.5
- AWWA Compliant C510
- Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California
- UL® Classified (less shut-off valves only)
- C-UL® Classified (less shut-off valves only)

#### MATERIALS

Main valve body Housing Fasteners Elastomers Cast Bronze, ASTM B 584 (3/4-1") Reinforced Nylon Stainless Steel, 300 Series Silicone (FDA Approved) Buna Nitrile (FDA Approved) Delrin, NSF Listed Stainless Steel, 300 series Cast Bronze, ASTM B 584 Forged Brass ASTM B 124

Internals Springs Ball Valves Struts

OPTIONAL STRAINER (MODEL S) H 2 2 4 4 50 00 757510 100 C 4 6 (1-1/4" - 2")

		DIMENSIONS (approximate)															WEIGHT																										
MODEL 350 SIZE		A		B LESS BALL VALVES		С		D		E		F		G		н		LESS BALL VALVES		WITH BALL VALVES																							
																						in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg	lbs.	kg
																						3/4	20	11	279	6 5/8	168	1 7/8	48	3 3/4	95	3	76	1 1/4	32	15 1/8	384	11 7/16	291	2.3	1.0	4.3	2.0
																						1	25	12 1/4	311	7	178	2 1/16	52			3 1/4		1 3/4			-	12 5/16	313	3.0	1.4	6.0	2.7
1-1/4	32	14 7/8	378	14 3/8	367	3 3/8	86	6 3/4	171	3 3/4	95	2 1/4	57	20 1/2	521	18 1/2	470	17.2	7.8	19	8.6																						
1-1/2	40	15 1/4	387	14 3/8	367	3 3/8	86	6 3/4	171	3 3/4	95	2 1/4	57	22	559	20 1/4	514	17	7.7	20	9.1																						
2	50	16	406	14 3/8	367	3 3/8	86	6 3/4	171	3 3/4	95	2 1/4	57	24	609	20 3/4	527	18	8.2	22	10																						
atent No. 7,434,593, 7,784,483 & 7,905,250) DOCUMENT #: BF-350SM													IT #:		REVISION: 3/13																												


Е

F

Page 1 of 2


WILKINS a Zurn company, 1747 Commerce Way, Paso Robles, CA 93446 Phone:805-238-7100 Fax:805-238-5766 In Canada: ZURN INDUSTRIES LIMITED, 3544 Nashua Dr., Mississauga, Ontario L4V 1L2 Phone:905-405-8272 Fax:905-405-1292 Product Support Help Line: 877-BACKFLOW (877-222-5356) • Website: http://www.zurn.com


#### FLOW CHARACTERISTICS

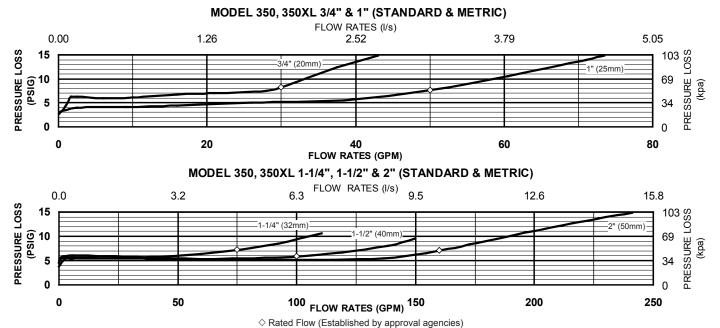


#### **TYPICAL INSTALLATION**

Local codes shall govern installation requirements. To be installed in accordance with the manufacturers' instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. If installed below grade, be certain adequate drainage is provided to prevent the device from being submerged.

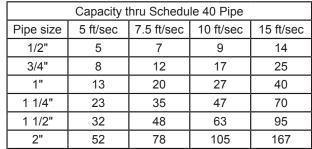



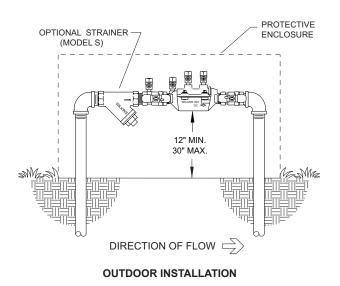

#### SPECIFICATIONS

The Double Check Valve Backflow Preventer shall be ASSE® Listed 1015, rated to 180°F and supplied with full port ball valves. The main body shall be Bronze for sizes 3/4" & 1", and Nylon for sizes 1-1/4" to 2". The housing shall be reinforced Nylon and the seat disc elastomers shall be silicone (FDA Approved). The first and second checks shall be accessible for maintenance without removing the device from the line. The Double Check Valve Backflow Preventer shall be a WILKINS Model 350.